



Bldg. Dept. 635.1060


Utilities 441.2020

Fire Marshal 635.1110

**Residential**  
March 2009

- Installation of meter horns are not allowed.
- 5/8" meters for residential, anything larger is commercial (3/4", 1", 1-1/2", 2" +).
- 1" Minimum water line size (k-copper/SR-11 with fusion).
- Call the Water Dept. to have the water meter sealed after installation.
- A rain sensor is required for all irrigation systems.
- Installation of a pressure reducer may be required in high-pressure zone areas (80psi +).
- Call the Water Dept. for more information.
- Full port ball valve shut-offs are required. (Gate valves are not allowed.)
- Deduct meters for irrigation systems are not allowed.
- Meters will be dropped off at the job location when called and paid for.
- Water main must be sleeved as to not come into contact with concrete.


**Residential**

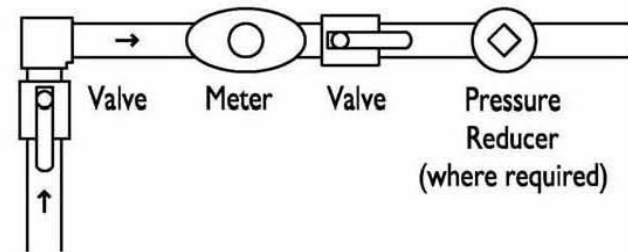

**Commercial**

- A bypass line must be installed for all meters 2" or larger (see drawing).
- Lockable shut-off valve must be installed in the bypass line.
- A rain sensor is required for all irrigation systems.
- Installation of a pressure reducer may be required in high-pressure zone areas (80psi +).
- Call the Water Dept. for more information.
- Meters will be dropped off at the job location when called and paid for.
- Deduct meters for irrigation systems are not allowed.
- If domestic water supply is 2" or larger, a bypass solenoid may be required for the fire sprinkler system.
- Water main must be sleeved as to not come into contact with concrete.
- Full port ball valve shut-offs are required. (Gate valves are not allowed.)
- Call the Water Dept. to have the water meter sealed after installation.

**Commercial**

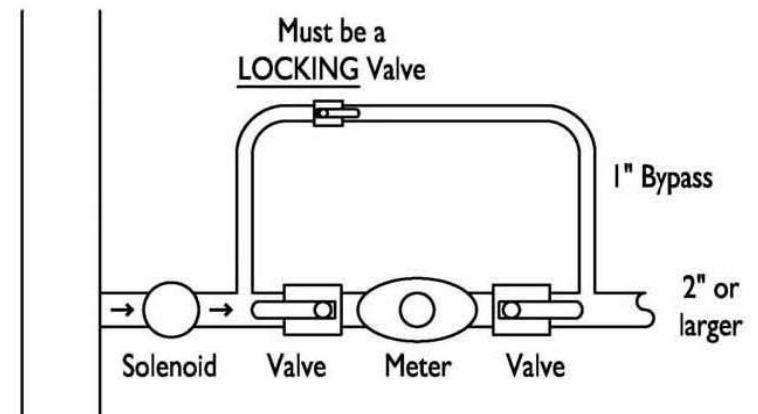

N:\Departments\Community Development\Building\Permits\Plumbing.doc 1/29/2013 Last Modified